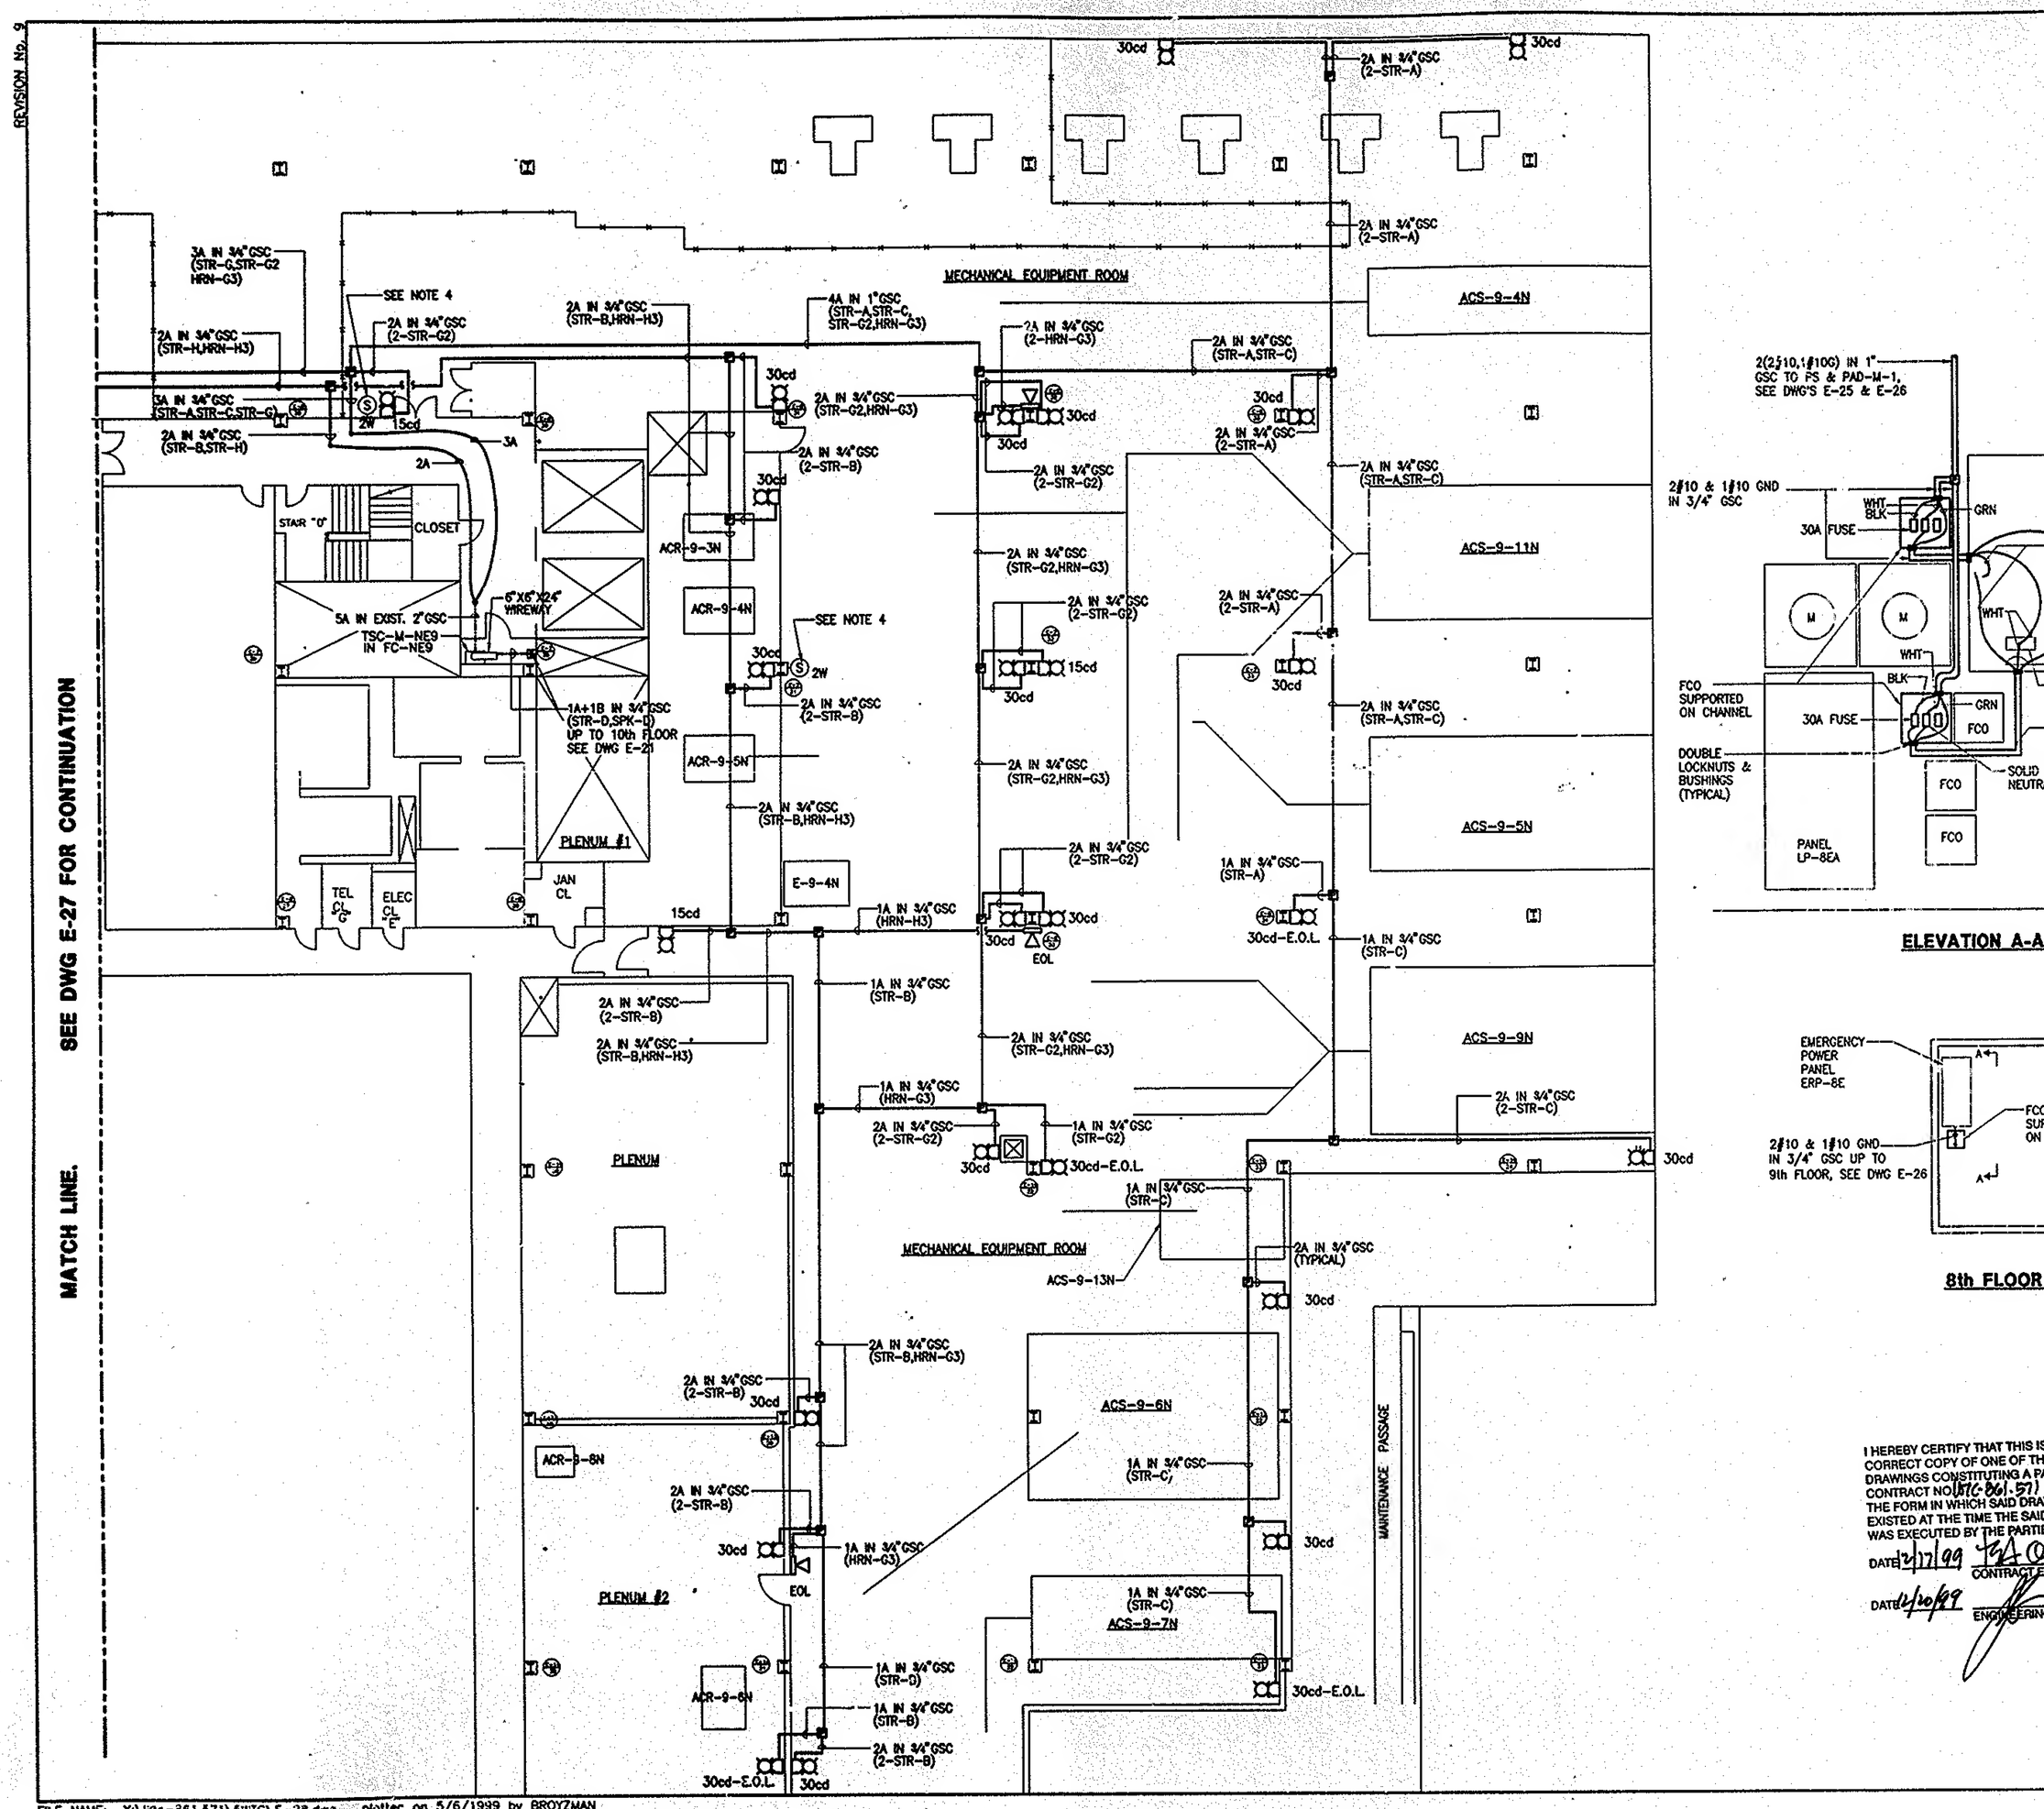
REVISION No. 9
MATCH LINE.
SEE DWG E-27 FOR CONTINUATION
MECHANICAL EQUIPMENT ROOM
ACS-9-4N
ACS-9-11N
ACS-9-5N
ACS-9-9N
ACS-9-6N
ACS-9-7N
ACS-9-13N
ACR-9-3N
ACR-9-4N
ACR-9-5N
ACR-9-6N
ACR-9-8N
E-9-4N
PLENUM #1
PLENUM
PLENUM #2
STAIR "0"
CLOSET
TEL CL "G"
ELEC CL "E"
JAN CL
MAINTENANCE PASSAGE
SEE NOTE 4
ELEVATION A-A
8th FLOOR
FCO SUPPORTED ON CHANNEL
DOUBLE LOCKNUTS & BUSHINGS (TYPICAL)
PANEL LP-8EA
30A FUSE
EMERGENCY POWER PANEL ERP-8E
I HEREBY CERTIFY THAT THIS IS
CORRECT COPY OF ONE OF TH
DRAWINGS CONSTITUTING A PA
CONTRACT NO. (WTC-861.57)
THE FORM IN WHICH SAID DRA
EXISTED AT THE TIME THE SAID
WAS EXECUTED BY THE PARTIE
DATE 2/17/99
DATE 2/20/99
FILE NAME: Y:\wtc-861.571\SWTC\E-28.dwg plotted on 5/6/1999 by BROYZMAN